



City of Santa Clara

Building Division
1500 Warburton Ave.
Santa Clara, CA 95050
www.santaclaraca.gov

Building Division: 408-615-2440

Email: Building@santaclaraca.gov


Permit Center: 408-615-2420

Email: PermitCenter@santaclaraca.gov

Automated Inspection Scheduling System: 408-615-2400

2016 CALIFORNIA CODES - OUTDOOR AIR CONDITIONING SYSTEM

Applicable codes: 2016 CNC (California Energy Code), 2016 CEC (California Electrical Code), 2016 CMC (California Mechanical Code). A plot plan (8 1/2 x 11 min. size paper) must be submitted showing property lines, house and other buildings on the lot, the physical size and location of the condensing unit, the dimensions of the unit and all distances from property lines. **ALL** outdoor units require Planning Division approval prior to installation. Duct system sealing and leakage testing is mandatory in all climate zones (CNC 150m11).

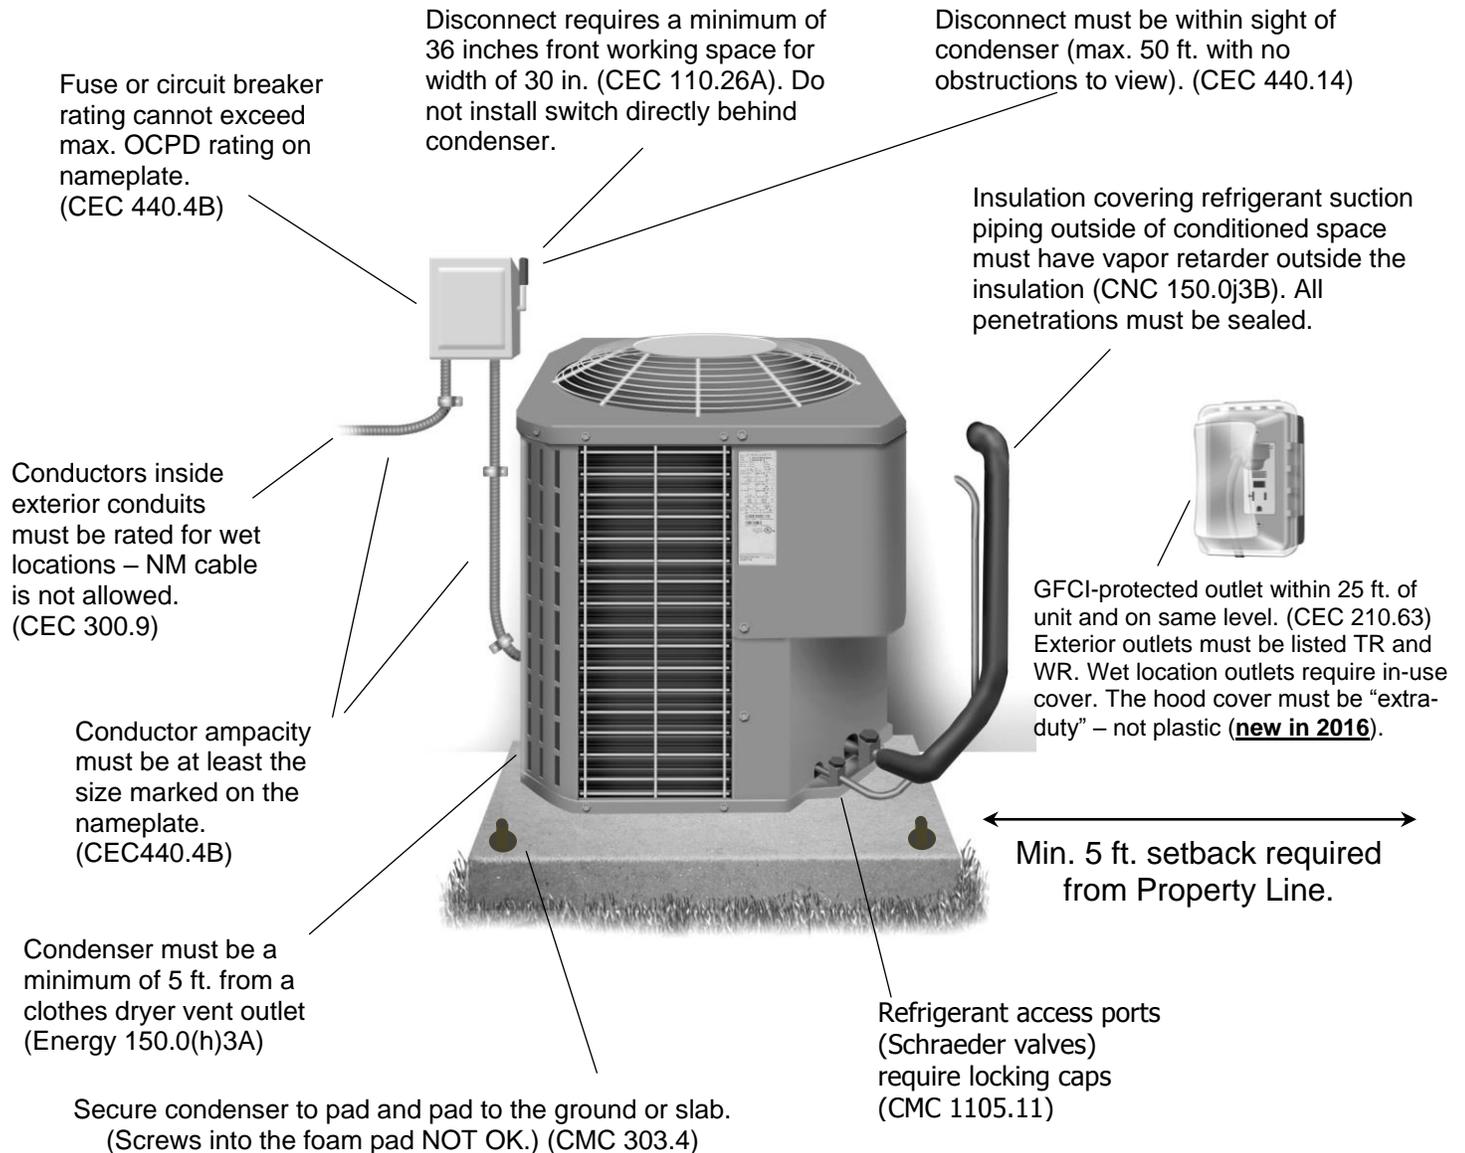

Effective 1/1/2015
Minimum energy efficiencies are
SEER 14 and EER 12.2

See handout GM01 for
condensate disposal
requirements