



City of Santa Clara
 Building Division
 1500 Warburton Ave.
 Santa Clara, CA 95050
 www.santaclaraca.gov


Building Division: 408-615-2440
 Email: Building@santaclaraca.gov
Permit Center: 408-615-2420
 Email: PermitCenter@santaclaraca.gov
 Automated Inspection Scheduling System: 408-615-2400

**2016 CALIFORNIA MECHANICAL CODE / CALIFORNIA PLUMBING CODE
 RESIDENTIAL CONDENSATE DISPOSAL REQUIREMENTS**

Air conditioner cooling coils require a condensate drain with a trap in accordance with the manufacturer's instructions [310.1]. The drain must discharge by gravity to a drywell or an indirect waste, or to a condensate pump that connects to an indirect waste. An indirect waste connection can be made to a janitor sink or laundry standpipe, an accessible inlet on a bathtub overflow, or to a lavatory tailpiece in the unit controlled by the same person controlling the air-conditioned space [CMC 310.6]. Condensate from a high efficiency (Category IV) furnace can be combined with the AC condensate. Condensate cannot be combined with the discharge of a temperature and pressure relief valve [CPC 608.5].

Condensate waste pipes must be at least 3/4 in. diameter and slope at least 1/8 inch per foot. Condensate pumps are allowed if interlocked to prevent AC operation during pump failure. Condensate pump discharge tubing must rise vertically to a point where it is possible to connect to a gravity condensate drain [CMC 310.1.1] (**new in 2016 CMC**)

Air conditioner cooling coils in an attic or over any other area where leakage could cause damage require protection to prevent damage in the event of a blocked drain. 4 methods are acceptable (**new in 2016 CMC**): (1) a drain pan that extends fully beneath the area of the cooling unit and equipped with a separate drain line; (2) a separate drain line at a higher location in the AC unit's drain pan; (3) a drain pan without a discharge line but equipped with a water-level detection device interlocked to the appliance; (4) a water-level detection device interlocked to the appliance – typically located in the drain trap. For methods 1 & 2, the discharge pipe must go to a location that is readily observed – typically over a window. [CMC 310.2] These requirements also apply to high-efficiency (Category IV) furnaces.

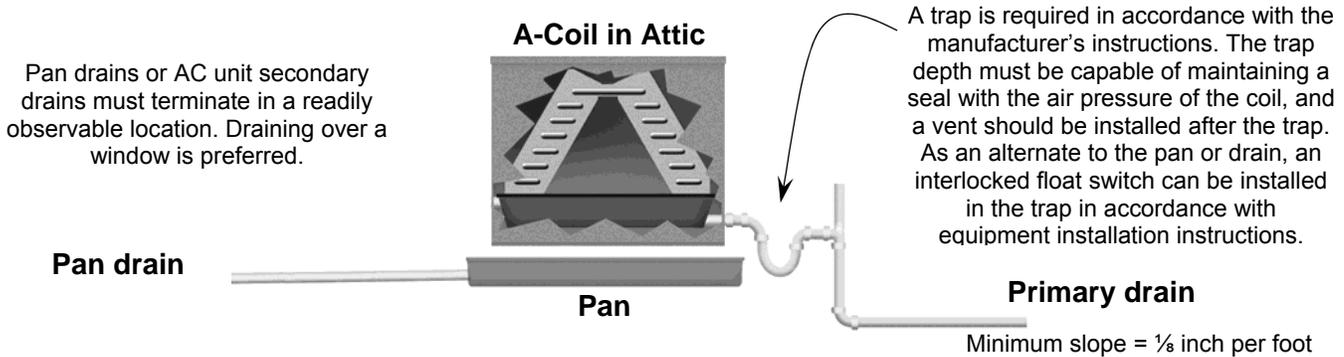

Residential condensate is typically terminated in drywells. Drywell specifications are as follows:

1. The minimum size of a residential drywell is 2 foot square by 2 foot deep.
2. The nearest edge of the drywell shall be at least 3 feet from any structure or building foundation.
3. The drywell shall be filled with minimum 1" rock.
4. The top of the drywell shall be covered with building paper or plastic sheeting with 6" of earth or concrete above the paper.
5. The condensate pipe from the cooling coil (min. 3/4") shall connect indirectly to a minimum 1 1/2 in. drainpipe. The indirect connection shall be made by an air break at the edge of the foundation.

