

SEE ENCLOSURE CONSTRUCTION NOTE 10

Underwriters Laboratories Inc.
File No. E62062

TESCO
TESCO CONTROLS INC.
916 322-2620
SACRAMENTO, CA.

T-
26-100

INDUSTRIAL CONTROL PANEL




VOLTAGE	PHASE	WIRES	MAINS AMPERES	HZ
120/240 OR 120/208	1	3	100	60

SUITABLE FOR USE ON A CIRCUIT CAPABLE OF DELIVERING NOT MORE THAN:

AMPERES	AT	VOLTAGE
10,000	RMS SYM.	240 v

METER SOCKET RATING: 100 A. CONT.
ENCLOSURE: TYPE 3R

SUITABLE ONLY FOR USE AS SERVICE EQUIPMENT

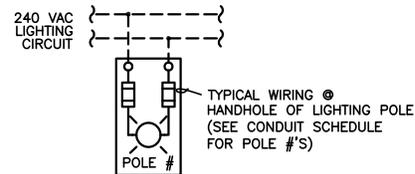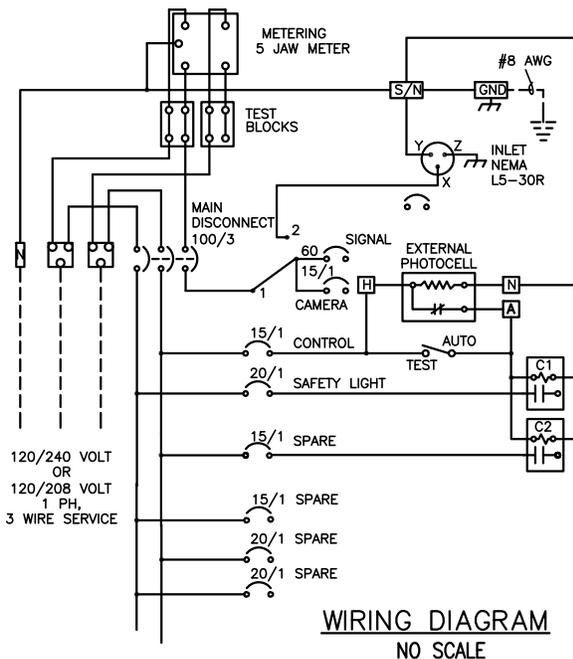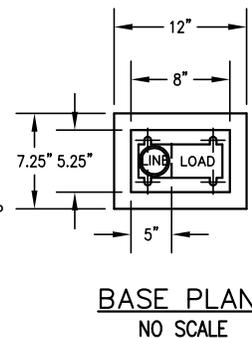

ENCLOSURE CONSTRUCTION NOTES:

1. FABRICATED FROM 1/8" ALUMINUM SHEET STOCK ELECTRICALLY WELDED AND REINFORCED WHERE REQUIRED.
2. CONSTRUCTION WILL BE NEMA 3R AND 12, RAIN TIGHT AND DUST TIGHT.
3. ALL NUTS, BOLTS, SCREWS AND HINGES SHALL BE STAINLESS STEEL.
4. NUTS, BOLTS & SCREWS SHALL NOT BE VISIBLE FROM OUTSIDE OF ENCLOSURE.
5. PHENOLIC NAMEPLATES SHALL BE PROVIDED AS REQUIRED.
6. CONTROL WIRING SHALL BE MARKED AT BOTH ENDS BY PERMANENT WIRE MARKERS.
7. A PLASTIC COVERED WIRING DIAGRAM SHALL BE ATTACHED TO THE INSIDE OF THE FRONT DOOR.
8. ENCLOSURE WILL BE FACTORY WIRED AND CONFORM TO REQUIRED NEMA STANDARD.
9. FINISH: ANODIZED ALUMINUM
10. PANEL SHALL BE TESCO TYPE III AF OR APPROVED EQUAL.



DRAWN BY: K. TRAN
CHECKED BY: B. TRAN
APPROVED BY: D. NG
DATE: OCTOBER 2013

**TRAFFIC SIGNAL
POWER PANEL**

CITY OF SANTA CLARA

TR-3

PAGE: 51